


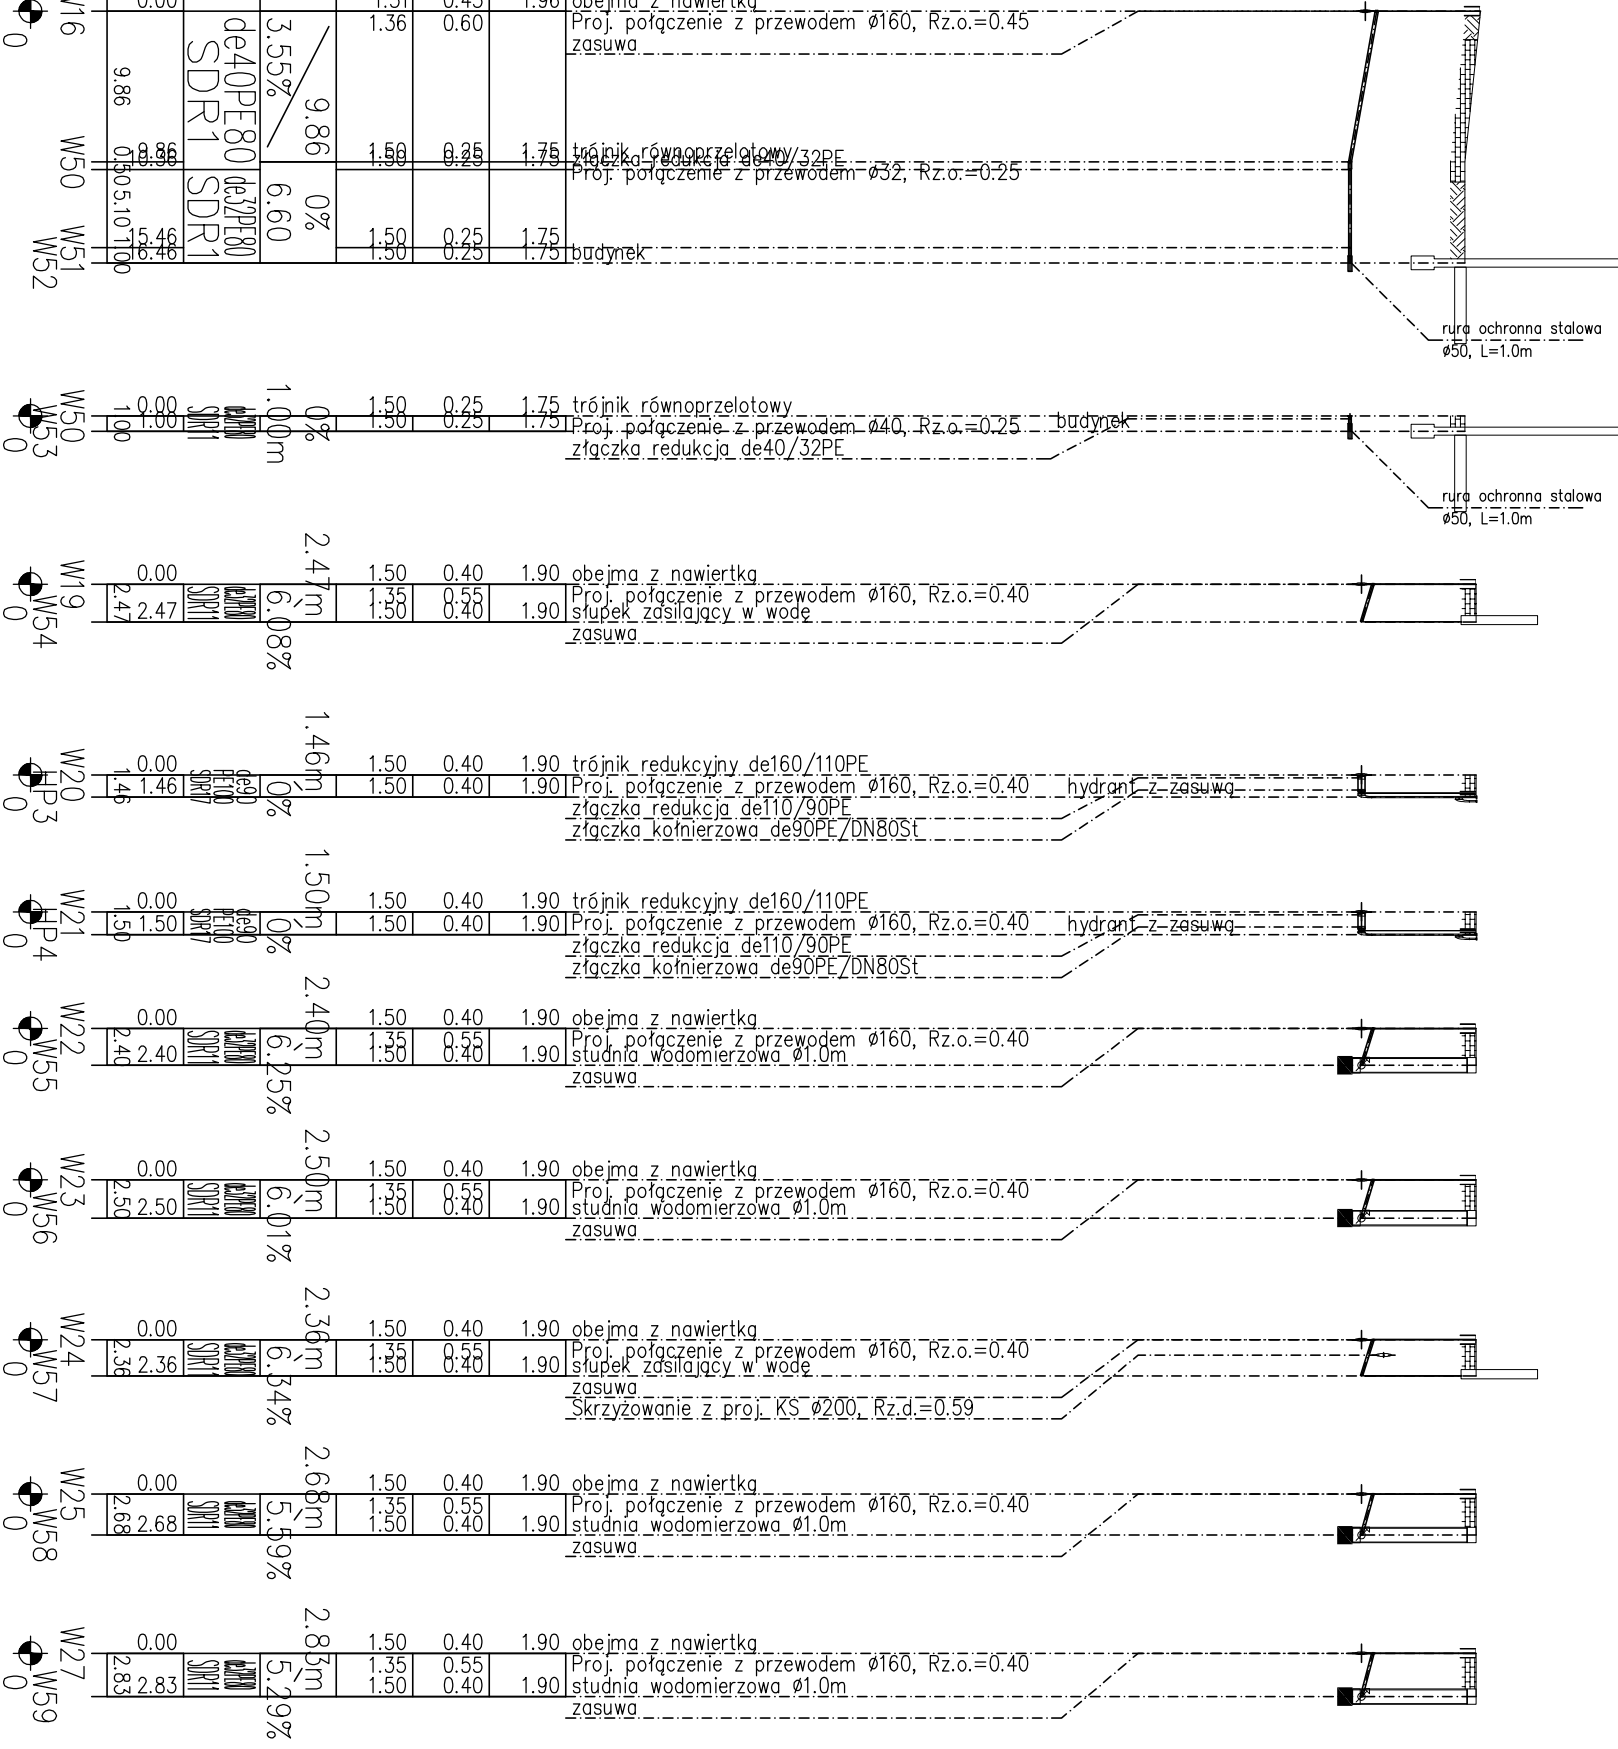

RZĘDNA TERENU ISTN.	1.96		1.75	1.75
RZĘDNA OSI RUROCIĄGU	0.45	0.60	0.25	0.25
ZAGŁĘBIENIE OSI RUROCIĄGU	1.51	1.36	1.50	1.50
SPADKI, DŁUGOŚCI	9.86 / 3.55%		0%	
ŚREDNICA, MATERIAŁ	de40PE80 SDR1		de32PE80 SDR1	
ODLEGŁOŚCI	0.00	9.86	0.00	9.86
HEKTOMETRY	W16	W50	W51	W52